

Room thermostats with KNX communications

RDG200KN & RDG260KN



For fan coil units, universal applications and compressors in DX-type equipment applications

- KNX bus communication (S-Mode, LTE-Mode)
- Built-in temperature and humidity sensor
- Control room temperature and humidity level
- Green leaf indication
- RDG200KN triac control outputs for On/Off, PWM or 3-position
- RDG260KN control outputs for DC 0...10 V or On/Off
- Fan outputs for 3-speed, 1-speed or DC 0...10 V
- 3 multifunctional inputs and 1 multifunctional output for keycard, external sensor, etc.
- Operating modes: Comfort, Economy and Protection
- Automatic or manual fan speed control
- Automatic or manual heating/cooling changeover
- Commissioning via local HMI or with tools such as Synco™ ACS or ETS
- Commissioning via Siemens smartphone application PCT Go
- Operating voltage:
 - RDG200KN: AC 24 V or AC 230 V (selectable)
 - RDG260KN: AC 24 V or DC 24 V

Functions

Control application	<p>The RDG2..KN KNX room thermostats are designed for use with the following:</p> <p>Fan coil units via On/Off or modulating/DC control outputs:</p> <ul style="list-style-type: none">• 2-pipe system• 2-pipe system with electric heater• 2-pipe system with radiator/floor heating• 2-pipe/2-stage system also suitable for applications with 1-stage heating/2-stage cooling or 2-stage heating/1-stage cooling• 4-pipe system• 4-pipe system with electric heater• 4-pipe system with PICV and 6-port ball valve as changeover (RDG260KN)• 4-pipe/2-stage system also suitable for applications with 1-stage heating/2-stage cooling or 2-stage heating/1-stage cooling <p>Chilled/heated ceilings (or radiators) via On/Off or modulating/DC control outputs:</p> <ul style="list-style-type: none">• Chilled/heated ceiling• Chilled/heated ceiling with electric heater• Chilled/heated ceiling and radiator/floor heating• Chilled ceiling and radiator/floor heating• Chilled and/or heated ceiling/2-stage• Chilled/heated ceiling (4-pipe) with 6-port ball valve (RDG260KN)• Chilled/heated ceiling with PICV and 6-port ball valve as changeover (RDG260KN) <p>Compressor applications via On/Off control:</p> <ul style="list-style-type: none">• Heating or cooling, compressor in DX-type equipment• Heating or cooling, compressor in DX-type equipment with electric heater• Heating and cooling, compressor in DX-type equipment• Heating or cooling/2-stage, compressor in DX-type equipment
General functions	<ul style="list-style-type: none">• Selectable weekly scheduler• Master/Slave function between thermostats• Room temperature control via built-in temperature sensor or external room temperature/return air temperature sensor• Room relative humidity control via built-in humidity sensor (humidity function can be disabled.)• Min./max. humidity control by shifting temperature setpoint and releasing contact for de-humidifier/humidifier• Delta temperature control Limiting temperature difference between inlet and return water to optimize system and reduce the energy consumption in district heating systems• Floor heating temperature limitation• Min. and max. supply air temperature limitation• Selection of operating modes via operating mode button• Button lock for all buttons independently (automatically or manually)• Changeover between heating and cooling mode (automatic via local sensor or bus, or manually)• Parameters protected by password (disabled by default)• Purge function together with 2-port valve• Valve kick/exercising function to prevent gripping• Reminder to clean fan filters

Setpoints and display	<ul style="list-style-type: none"> • Min. and max. limitation of room temperature setpoint: <ul style="list-style-type: none"> – Comfort limitation (min. and max. limitation) – Energy saving concept (min. and max. limitation separate for heating and cooling) • Temporary Comfort mode extension • Green leaf indication function • Display of current room temperature or setpoint in °C, °F or both • Absolute and relative setpoint indication
Setting	<ul style="list-style-type: none"> • Application selection via DIP switches or external commissioning software (ACS, ETS and Siemens smartphone application PCT Go) • Parameter download with external commissioning software (ACS, ETS and Siemens smartphone application PCT Go) • Reloading factory settings for commissioning and control parameters
Fan	<ul style="list-style-type: none"> • 1-speed, 3-speed or DC 0...10 V fan control on RDG200KN and RDG260KN (automatic or manual fan) • Advanced fan control function, e.g. fan kick, fan start delay, selectable fan operation (enable, disable, depending on heating/cooling mode, or min. and max. speed setting) • Fan start depending on fan coil temperature (heating) to avoid cool air while heating • Enabling fan output only in the 2nd stage (2-pipe/2-stage) • Switching fan speed from manual to automatic in the dead zone to avoid energy waste (selectable function)
Special functions	<ul style="list-style-type: none"> • Swap function for 2-pipe and 2-stage application by switching the 1st stage heating to 2nd stage cooling • In 2-stage applications (2-/4-pipe), limit the number of heating or cooling sequence to one • Control of 6-port ball valve for chilled and heated ceiling, DC 0...10 V, DC 2...10 V and inverted signals DC 10...0 V, DC 10...2 V (RDG260KN) • Control of 6-port ball valve as changeover (On/Off – open/close signal) and PICV DC 0...10 V for <ul style="list-style-type: none"> – Chilled and heated ceiling/floor (RDG260KN) – Fan coil application (RDG260KN) • Control of 6-port ball valve via KNX S-Mode objects (RDG200KN and RDG260KN) • Flow limitation function for PICV in heating mode (RDG260KN) • Setting holiday period to reduce waste of energy during absence (holiday)
Inputs/outputs	<ul style="list-style-type: none"> • 2 multifunctional inputs X1, X2 and 1 multifunctional input/output U1 set as input, selectable for: <ul style="list-style-type: none"> – Window contact switches operating mode to Protection – Presence detector switches operating mode to Comfort – Sensor for automatic heating/cooling changeover – Switch for manual heating/cooling changeover – External room temperature or return air temperature sensor – Dewpoint sensor – Enable electric heater – Fault input – Monitor input for temperature sensor or switch status – Supply air temperature sensor

- Coil temperature sensor
- External temperature limit
- Hotel presence detector
- 1 multifunctional input/output U1 automatically set as output for:
 - 4-pipe/2-stage as 2nd stage cooling output
- Selectable relay functions
 - Switching off external equipment during Protection mode
 - Switching on external equipment (e.g. pump) during heating/cooling demand
 - Output status heating/cooling sequence
 - Dehumidification/humidification control output

KNX communication features

- KNX bus (terminals CE+ and CE-) for communication with Synco™ devices or KNX compatible devices
- Master-slave function via LTE-Mode or S-Mode to synchronize equipment and save energy in open spaces
- Master-slave alarm management via LTE-Mode allows slave alarms display on master
- Display of outside temperature or time of day from KNX bus
- Time scheduling and central control of setpoints from KNX bus
- Control of Economy setpoints via KNX bus
- Relative humidity setpoint via KNX bus
- Control of KNX actuators and fan via S-Mode objects
- Energy supply optimization via energy demand signal via Synco™ RMB795B central control unit
- Interworking with Siemens AQR.. and QMX.. sensors for room humidity and room temperature measurement
- Interworking with Siemens QMX.. room operator units for room humidity, room temperature and operating commands for fan, operating mode and setpoints
- Commissioning KNX area, line and device address via mobile application PCT Go

Power supply selection for RDG200KN

The RDG200KN can be powered either on AC 230 V (default) or AC 24 V.
To select the correct power supply, use the power switch on the rear of the device.



Note:

The outputs (triacs and relays) follow the main power supply, either AC 230 V or AC 24 V.
The device will be damaged if set to AC 24 V, but powered on AC 230 V.

Applications

Remote configuration

The RDG2..KN room thermostats support the following applications, which can be configured using the DIP switches on the rear of the unit or via the commissioning tool.
Set DIP switches 1...5 to Off (remote configuration, factory setting) to select an application via commissioning tool.

Remote configuration via commissioning tool (factory setting) <ul style="list-style-type: none"> • Synco™ ACS • ETS • Commissioning via Siemens smartphone application PCT Go 	ON =  DIP NO.: 1...5
	OFF =  DIP NO.: 1...5

Applications for fan coil systems

Applications, DIP setting, control outputs					
<ul style="list-style-type: none"> 2-pipe fan coil unit 		<ul style="list-style-type: none"> 2-pipe fan coil unit with electric heater 		<ul style="list-style-type: none"> 2-pipe fan coil unit with radiator/floor heating 	
	Using RDG200KN, RDG260KN		Using RDG200KN, RDG260KN		Using RDG200KN, RDG260KN
<ul style="list-style-type: none"> 2-pipe/2-stage fan coil unit 		<ul style="list-style-type: none"> 4-pipe fan coil unit 		<ul style="list-style-type: none"> 4-pipe fan coil unit with electric heater 	
	Using RDG200KN, RDG260KN		Using RDG200KN, RDG260KN		Using RDG200KN, RDG260KN
<ul style="list-style-type: none"> 4-pipe fan coil unit with PICV and 6-port ball valve as changeover 		<ul style="list-style-type: none"> 4-pipe/2-stage fan coil unit ¹⁾ 		<p>YHC Heating/cooling valve actuator YH Heating valve actuator YC Cooling valve actuator YE Electric heater M1 1-speed or 3-speed fan, DC 0...10 V fan B1 Return air temperature sensor or external room temperature sensor (optional) B2 Changeover sensor (optional)</p> <p>¹⁾ 4-pipe/2-stage: Output can be set to 2-stage heating/1-stage cooling or 1-stage heating/2-stage cooling</p>	
	Using RDG260KN		Using RDG200KN, RDG260KN		



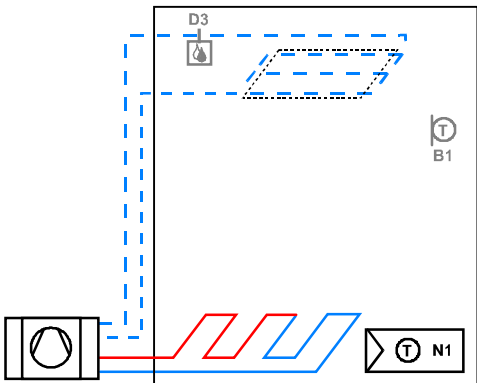
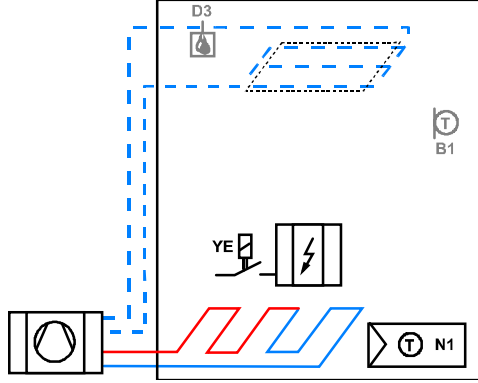


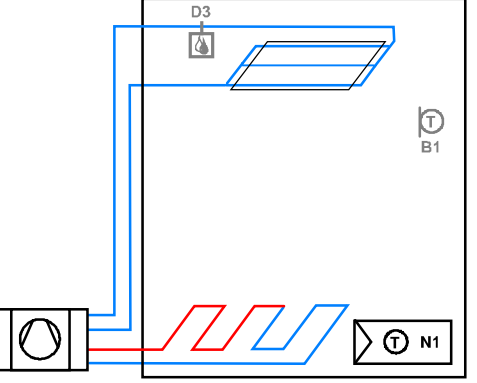
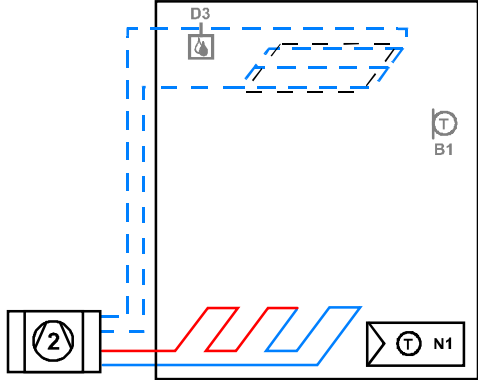
Product No.	Control output	Fan output
RDG200KN	PWM, On/Off, 3-pos	3-speed, 1-speed, DC 0...10 V
RDG260KN	DC 0...10 V	3-speed, 1-speed, DC 0...10 V
	On/Off	DC 0...10 V

Applications for universal systems

Applications, DIP setting, control outputs					
<ul style="list-style-type: none">Chilled/heated ceiling		<ul style="list-style-type: none">Chilled/heated ceiling and electric heater		<ul style="list-style-type: none">Chilled/heated ceiling and radiator/floor heating	
	319/S11		319/S12		319/S14
Using RDG200KN, RDG260KN		Using RDG200KN, RDG260KN		Using RDG200KN, RDG260KN	
<ul style="list-style-type: none">2-stage chilled/heated ceiling		<ul style="list-style-type: none">Chilled ceiling and radiator		<ul style="list-style-type: none">Chilled and heated ceiling control with 6-port ball valve	
	319/S15		319/S13		319/S16
Using RDG200KN, RDG260KN		Using RDG200KN, RDG260KN		Using RDG260KN	
<ul style="list-style-type: none">Chilled and heated ceiling control with PICV and 6-port ball valve as changeover		<ul style="list-style-type: none">2-stage chilled and heated ceiling		<p>YHC Heating/cooling valve actuator YH Heating valve actuator YC Cooling valve actuator YE Electric heater D3 Dewpoint sensor M1 1-speed or 3-speed fan, DC 0...10 V fan B1 Return air temperature sensor or external room temperature sensor (optional) B2 Changeover sensor (optional)</p>	
	319/S17		A6V11545853S03		
Using RDG260KN		Using RDG200KN, RDG260KN			

Product No.	Control outputs
RDG200KN	On/Off, PWM, 3-position
RDG260KN	On/Off, DC 0...10 V

Application for heat pump systems

Applications, DIP setting, control outputs				
<ul style="list-style-type: none"> Heated or cooled with compressors 		<ul style="list-style-type: none"> Heated or cooled with compressors with electric heater 		
 <p>Using RDG200KN, RDG260KN</p>		 <p>Using RDG200KN, RDG260KN</p>		
<ul style="list-style-type: none"> Heated and cooled with compressors 		<ul style="list-style-type: none"> 2-stage heated or cooled with compressors 		
 <p>Using RDG200KN, RDG260KN</p>		 <p>Using RDG200KN, RDG260KN</p>		
N1 Thermostat Output Y10/Q1: Heating or heating/cooling Output Y20/Q2: Cooling only (heating/cooling)		B1 Return air temperature sensor or external room temperature sensor (optional)		
YE Electric heaters		D3 Dewpoint sensor		
Product No.	Control output	Fan		
RDG200KN	On/Off	Disabled, 1-speed, 3-speed, DC 0...10 V		
RDG260KN	On/Off	Disabled, DC 0...10 V		

Type summary

For fan coil units, universal applications and compressors in DX-type equipment applications

Product no.	Stock no.	Operating voltage	Fan		Number of control outputs					Built-in sensor
			3-speed	DC	On/Off	PWM	3-pos	DC	On/Off (3-wire)	Humidity, temperature
RDG200KN	S55770-T409	AC 24 V or AC 230 V	✓	✓ ¹⁾	4	4	2	–	2	✓
RDG260KN	S55770-T412	AC 24 V or DC 24 V	✓	✓ ¹⁾	–	–	–	3	–	✓
			–	✓ ¹⁾	2 ²⁾	–	–	–	–	

¹⁾ The terminal Y50 is used as DC 0...10 V output.

²⁾ The output is relay On/Off.

Accessories

Type	Product/stock no.	Datasheet
KNX power supply 160 mA (Siemens BT LV)	5WG1 125-1AB02	TPI_N125
KNX power supply 320 mA (Siemens BT LV)	5WG1 125-1AB12	TPI_N125
KNX power supply 640 mA (Siemens BT LV)	5WG1 125-1AB22	TPI_N125
Adapter plate for RDG2..KN ¹⁾	ARG200: S55770-T438	-




¹⁾ ARG200 mounting plate is used for RDG2..KN mounting on the walls without conduit box. For dimensions, see Dimensions [► 30].







Ordering

When ordering, specify both product number / stock number and name: e.g. **RDG200KN / S55770-T409 room thermostat**

Order valve actuators and accessories separately.

Equipment combinations





Type of unit		Product no.	Datasheet ¹⁾
Cable temperature or changeover sensor, cable length 2.5 m NTC (3 kΩ at 25 °C)		QAH11.1	1840
Cable temperature sensor PVC 2 m, LG-Ni1000		QAP22	1831
Room temperature sensor NTC (3 kΩ at 25 °C)		QAA32	1747

Type of unit		Product no.	Datasheet ^{*)}
Room temperature sensor LG-Ni1000		QAA24	1721
Front modules with passive temperature measurement LG-Ni1000		AQR2531ANW	1408
Strap-on temperature sensor LG-Ni1000		QAD22	1801
Condensation monitor		QXA21..	A6V10741072
Flush-mount KNX room sensor (base and front module)		AQR2570N.. AQR2532NNW AQR2533NNW AQR2535NNW	1411
Wall-mounted KNX sensors		QMX3.P30 QMX3.P70	1602




On/Off actuators






Type of unit		Product no.	Datasheet ^{*)}
Electromotive On/Off actuator		SFA21.. SFA71..	4863

On/Off and PWM actuators ¹⁾






Type of unit		Product no.	Datasheet ^{*)}
Thermal actuator (for radiator valves) AC 230 V, NO		STA23.. ¹⁾	4884
Thermal actuator (for radiator valves) AC 24 V, NO		STA73.. ¹⁾	4884
Thermal actuator AC 230 V (for small valves 2.5 mm), NC		STP23.. ¹⁾	4884
Thermal actuator AC 24 V (for small valves 2.5 mm), NC		STP73.. ¹⁾	4884

3-position actuators AC 230 V






Type of unit		Product no.	Datasheet ^{*)}
Electric actuator, 3-position (for radiator valves) AC 230 V		SSA31..	4893
Electric actuator, 3-position (for 2- and 3-port valves/V..P45) AC 230 V		SSC31	4895
Electric actuator, 3-position (for small valves 2.5 mm) AC 230 V		SSP31..	4864




Type of unit		Product no.	Datasheet *)
Electric actuator, 3-position (for small valves 5.5 mm) AC 230 V		SSB31..	4891
Electric actuator, 3-position (for small valve 5 mm) AC 230 V		SSD31..	4861
Electric actuator, 3-position (for valves 5.5 mm) AC 230 V		SAS31..	4581
Rotary actuators for ball valves, 3-position		GDB331.9E	4657
Rotary actuators for ball valves, 2 or 3-position		GDB141.9E GDB341.9E	A6V10636150

3-position actuators
AC 24 V


Type of unit		Product no.	Datasheet *)
Electric actuator, 3-position (for radiator valves) AC 24 V		SSA81..	4893
Electric actuator, 3-position (for 2- and 3-port valves/V..P45) AC 24 V		SSC81	4895
Electric actuator, 3-position (for small valves 2.5 mm) AC 24 V		SSP81..	4864
Electric actuator, 3-position (for small valves 5.5 mm) AC 24 V		SSB81..	4891
Electric actuator, 3-position (for small valve 5 mm) AC 24 V		SSD81..	4861

DC 0...10 V actuators

Type of unit		Product no.	Datasheet *)
Electric actuator, DC 0...10 V (for radiator valves)		SSA61..	4893
Electric actuator, DC 0...10 V (for 2- and 3-port valves/V..P45)		SSC61..	4895
Electric actuator, DC 0...10 V (for small valves 2.5 mm)		SSP61..	4864
Electric actuator, DC 0...10 V (for small valves 5.5 mm)		SSB61..	4891
Electromotive actuator, DC 0...10 V (for valves 5.5 mm)		SAS61..	4581

Type of unit		Product no.	Datasheet ^{*)}
Electrothermal actuator, AC 24 V, NC, DC 0...10 V, 1 m		STA63	4884
Electrothermal actuator, AC 24 V, NO, DC 0...10 V, 1 m		STP63	4884
Rotary actuators for ball valves AC 24 , DC 0...10 V		GDB161.9E	4657

KNX actuators

Type of unit		Product no.	Datasheet ^{*)}
Rotary actuators for ball valves KNX S-Mode		GDB111.9E/KN	A6V10725318

^{*)}The documents can be downloaded from <https://hit.sbt.siemens.com>

¹⁾ With PWM control, exact parallel run of 2 or more thermal actuators is not possible . If several fan coil units are controlled by the same room thermostat, motorized actuators with On/Off or 3-position control are preferred.

Note:

For more information about parallel operation and the max. number of actuators that can be used, refer to the data sheets of the selected actuator type and the following list:

Max. number of actuators in parallel on RDG200KN (AC 230 V):

- 6 SS..31.. actuators (3-position)
- 4 ST..23.. if used with On/Off control signal
- 10 SFA.., SUA.., MVI.., MXI.. On/Off actuators
- Parallel operation of SAS31 not available

Max. number of actuators in parallel on RDG200KN (AC 24 V):

- 6 SS..81.. actuators (3-position)
- 4 ST..73.. if used with On/Off control signal
- 2 SFA71.. On/Off actuators
- Parallel operation of SAS81 not available

Max. number of actuators in parallel on RDG260KN (AC 24 V):

- 10 SS..61.. actuators (DC)
- 10 ST..23/63/73.. actuators (DC or On/Off)
- 10 SFA.., SUA.., MVI.., MXI.. On/Off actuators
- 10 SAS61.. actuators (DC)
- 10 GDB161.9E

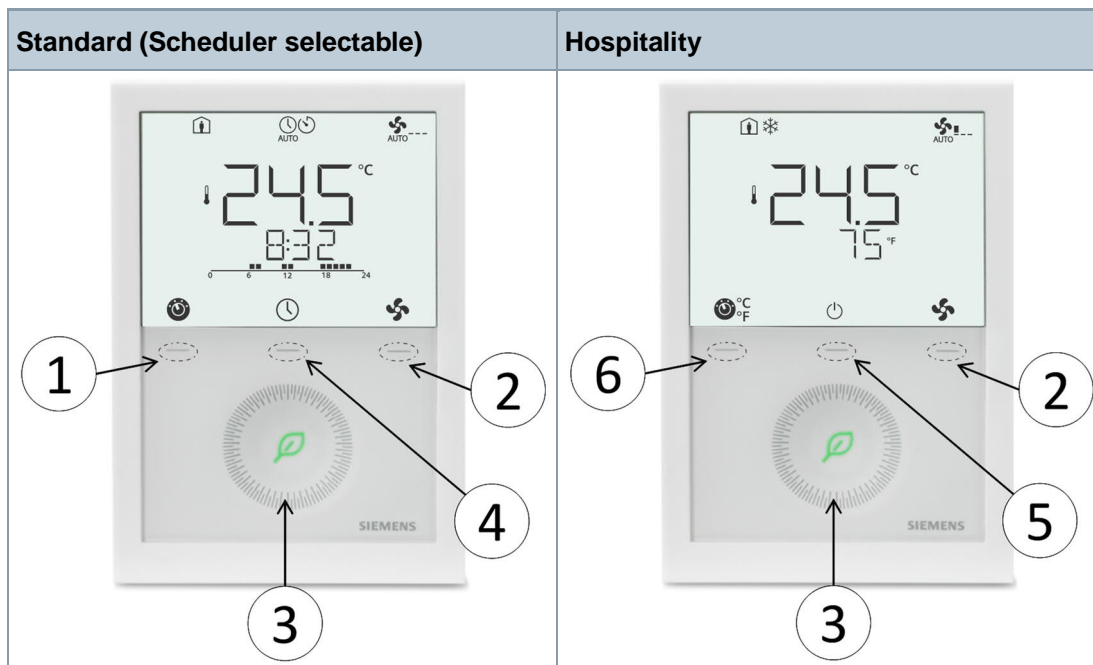
Mechanical design






The room thermostat consists of two parts:


- Plastic housing with electronics, operating elements, and room temperature sensor
- Mounting plate with screw terminals

The housing engages in the mounting plate and is secured with 2 screws.

Operation and settings



Number	Description
①	 Operating mode button/Esc
②	 Fan mode button/OK
③	Capacitive rotary knob to adjust setpoints and parameters
④	 local schedule setting button, the scheduler is enabled via P005
⑤	 Protection hospitality mode button
⑥	 ^{°C} ^{°F} Unit switching between °C and °F

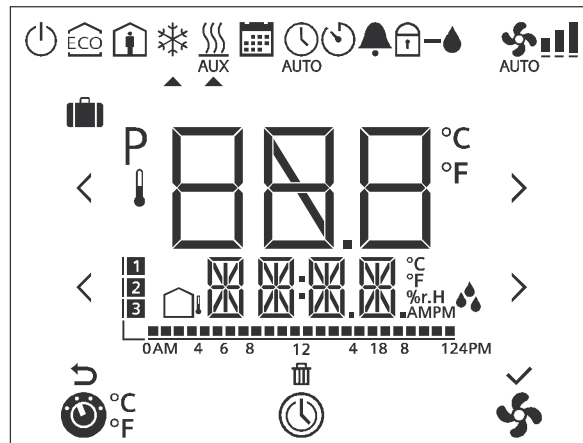

#	Symbol	Description	#	Symbol	Description
1		Operating mode selection/Unit switching	2		Scheduler
3		Fan speed selection	4		Escape
5		Delete schedule	6		Confirm parameters
7		Time bar for schedule	8		Number of schedules or slave alarms
9		Outside temperature	10		Additional user information, such as outside temperature, time of day from KNX bus, relative humidity
11	AMPM	Morning: 12-hour format Afternoon: 12-hour format	12		Relative humidity
13		Degrees Celsius or Fahrenheit	14	P	Parameter
15		Value with thermometer: Digits for room temperature display	16		Digits for setpoint display
17		Holiday mode	18		Protection mode
19		Economy mode	20		Comfort mode
21		Cooling mode	22		Heating mode, electric heater active
23		Heating mode	24		Manual changeover, heating/cooling mode
25		Scheduler mode	26		Auto mode
27		Temporary timer	28		Fault
29		Button lock	30		Condensation in room (dewpoint sensor active) or humidity control active
31		Automatic fan	32		Fan speed
					Fan speed I
					Fan speed II
					Fan speed III

Green leaf indication

Green leaf indication (green or red leaf) informs the user if the equipment runs within energy-efficient setting range (leaf is green).



When the user setting exceeds the preset energy-efficient range, the leaf color changes to red. End user can press the red leaf to return to the energy-efficient range.

The functions are defined as follows:

- Green leaf: Settings are within the preset energy-efficient range:
 - Setpoint range is defined by the Comfort basic setpoint (P011) plus/minus the energy indicator range (P111). It is valid for the setpoint concept comfort (P010 = 1) only
 - Fan speed: Manual fan is below or equals to auto fan speed value
 - Operating mode: Manual mode lower or equals to scheduler mode
- Red leaf: Settings exceed the preset energy-efficient range

P110 configures the green leaf function:

- 0 = Disabled (OFF)
- 1 = Green and red dimmed down
- 2 = Green dimmed down / red fixed
- 3 = Green and red fixed

	
Energy-efficient setting	Exceed the preset energy-efficient range Touch to reset user setting

Title	Document ID
Mounting instructions	A6V11546008
Operating instructions	A6V11545973
Basic documentation	A6V11545892
CE declarations	A5W00120120A
RCM	A5W00120121A
Environmental product declaration	RDG200KN: A5W00085404A RDG260KN: A5W00116569A

Related documents such as environmental declarations, CE declarations, etc., can also be downloaded at the following Internet address:

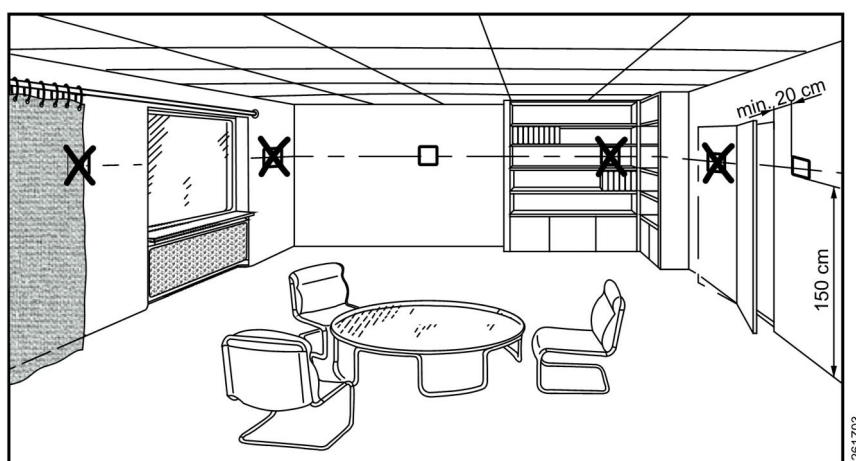
<http://siemens.com/bt/download>

Notes

Security

	<p>⚠ CAUTION</p> <p>National safety regulations</p> <p>Failure to comply with national safety regulations may result in personal injury and property damage.</p> <ul style="list-style-type: none"> Observe national provisions and comply with the appropriate safety regulations.
--	--

Mounting and installation



Mounting

- The devices are suitable for wall mounting.
- Recommended height: 1.5 m above the floor.
- Do not mount the devices in recesses, shelves, behind curtains or doors, or above or near heat sources.

- Avoid direct solar radiation and drafts.
- Avoid unheated (uncooled) building area such as outside walls.
- Seal the conduit box or the installation tube if any, as air currents can affect sensor readings.
- Adhere to allowed ambient conditions.
- An external room temperature sensor is recommended if above situations cannot be avoided in the installation area.

Wiring

- Comply with local regulations to wire, protect and earth the thermostat.
- ⚠ **Warning! No internal line protection for supply lines to external consumers (Q1, Q2, Q3, Yx or Yxx)! Risk of fire and injury due to short-circuits!**
- Adapt the line diameters as per local regulations to the rated value of the installed over current protection device.
- The AC 230 V mains supply line must have an external circuit breaker with a rated current of no more than 10 A.
- ⚠ Properly size the cables to the thermostat, fan and valve actuators for AC 230 V mains voltage.
- ⚠ Use valve actuators rated for AC 230 V / AC 24 V / DC 24 V depending on mains voltage.
- ⚠ Inputs X1-M, X2-M or U1-M: Multiple switches (e.g. summer/winter switch) may be connected in parallel. Consider overall maximum contact sensing current for switch rating.
- ⚠ When mains voltage is AC 230 V, SELV inputs X1-M, X2-M and U1-M use cables with min. 230 V insulation.
- Selectable relay function: Follow instructions in basic documentation A6V11545892 (Relay functions) to connect external equipment to the relay outputs.
- ⚠ Disconnect thermostat from power supply before removing from the mounting plate.
- ⚠ If a KNX bus power supply is connected to the line with communicating thermostats and Synco™ controller, the internal KNX power supply of the Synco™ controllers must be switched off.

Commissioning


Applications and settings	<p>The room thermostats are delivered with a fixed set of applications and related parameters. Select and activate the relevant application and settings during commissioning using one of the following tools:</p> <ul style="list-style-type: none"> • Local DIP switches and HMI • Synco™ ACS • ETS5 or higher versions • Siemens smartphone application PCT Go
DIP switches	<p>Set the DIP switches before snapping the thermostat to the mounting plate when selecting an application via DIP switches.</p> <p>Set all DIP switches to Off (remote configuration) when selecting an application via commissioning tool.</p> <p>After power is On, the thermostat resets and all LCD segments light up, indicating that reset is correct. After the reset of 3 seconds, the thermostat is ready for commissioning by qualified HVAC staff.</p> <p>If all DIP switches are Off, NO APPL displays, indicating that application commissioning via a tool is required.</p>
Commissioning via Siemens smartphone application PCT Go	<p>The setting via the Siemens smartphone application Product Commissioning Tool (PCT Go) is used to set the application and parameters settings of the thermostat.</p> <p>DIP switches can be either all set to Off or preset with an application. (DIP switch setting has higher priority.)</p>

This tool allows for wireless setting of the thermostat with smartphone and read/write parameters.

The commissioning tool works directly after users scan either the antenna area of the thermostat or the NFC area on the individual package box.

In addition, users can:

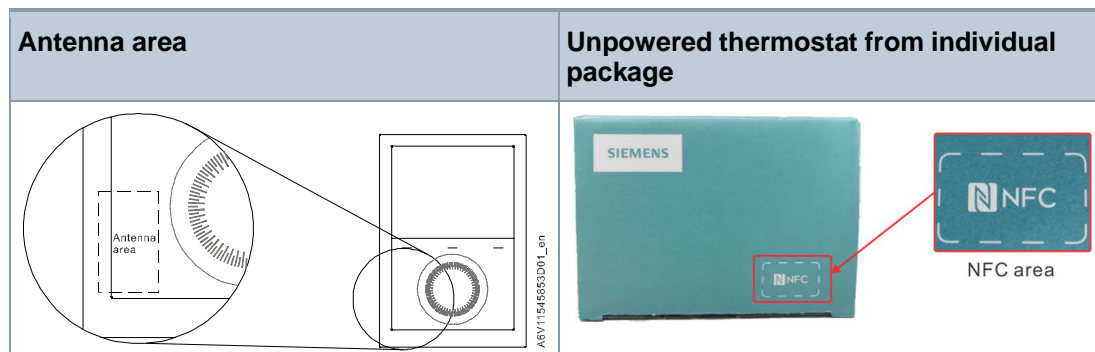- Scan the antenna area without powering on the thermostat.
- Scan the NFC area without unpacking the thermostat from the individual box.




Notes

- Each time the application is changed, the thermostat reloads the factory settings for all control parameters excepting KNX device and zone addresses.
- The commissioning via Siemens smartphone application PCT Go can be disabled via parameters to avoid unexpected changes of the thermostat.

Connect tools

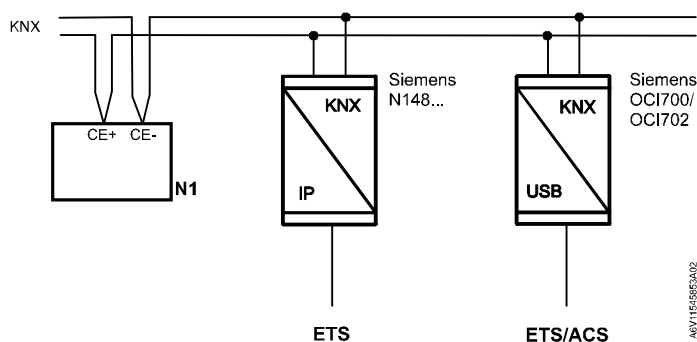Connect the Synco™ ACS or ETS tools to the KNX bus cable at any point for commissioning.



ACS and ETS require an interface:

- KNX interface (e.g. Siemens N148...)
- OC1702 USB-KNX interface

Control sequence

Set the control sequence via parameter P001 depending on the application. Factory setting:

Application	Factory setting P001
2-pipe and chilled/heated ceiling, and 2-stage	1 = cooling only
4-pipe, chilled ceiling and radiator, 6-port ball valve applications, and 2-stage	4 = heating and cooling

Calibrate sensor	Recalibrate the temperature sensor, if the room temperature displayed on the thermostat does not match the room temperature measured (after min. 1 hour of operation). To do this, change parameter P006.
Setpoint and range limitation	We recommend to review the setpoints and setpoint ranges (P011, P013...P016, P019, P020) and change them as needed to achieve maximum comfort and save energy.
Programming mode	<p>The programming mode helps identify the thermostat in the KNX network during commissioning.</p> <p>Touch both the left and right buttons simultaneously for 6 seconds to activate programming mode, indicated on the display by PROG.</p> <p>Programming mode remains active until thermostat identification is complete.</p>
Assign KNX address	<p>Assign complete KNX address (area, line and device) via:</p> <ul style="list-style-type: none"> • HMI or Siemens smartphone application PCT Go by setting parameters P898 (area address), P899 (line address) and P900 (device address) • ACS or ETS (P900: device address) <p>Set the device address to 255 to deactivate the communication (no exchange of process data).</p>
Assign KNX group address	Use ETS to assign the KNX group addresses of the thermostat's communication objects.
KNX serial number	<p>Each device has a unique KNX serial number on the rear.</p> <p>An additional sticker with the same KNX serial number is enclosed in the package. This sticker is intended for documentation purposes of installers.</p>

Disposal



The device is considered an electronic device for disposal in accordance with the European Guidelines and may not be disposed of as domestic garbage.

- Dispose of the device through channels provided for this purpose.
- Comply with all local and currently applicable laws and regulations.


Open Source Software (OSS)



All open source software components used within the product (including their copyright holders and the license conditions) can be found from the website


<http://www.siemens.com/download?A6V12046962>.



Warranty

Technical data on specific applications are valid only together with Siemens products listed under "Equipment combinations". Siemens rejects any and all warranties in the event that third-party products are used.

Power supply (RDG200KN)	
Operating voltage (L-N)	AC 24 V ± 20 % or AC 230 V $+10/-15$ % (selectable via slider)
Frequency	50/60 Hz
Power consumption	4 VA @ AC 24 V 7 VA @ AC 230 V
 <ul style="list-style-type: none"> No internal fuse! <p>External preliminary protection with max. C 10 A circuit breaker required in all cases.</p> <ul style="list-style-type: none"> Before switching on power, select the right power supply needed using the power switch on the rear of the device. 	

Outputs (RDG200KN)	
Fan control Q1, Q2, Q3 – N	AC 24 V or AC 230 V (linked to power supply)
Qx rating min., max. resistive (inductive)	5 mA...5 (4) A
 <p>No internal fuse!</p> <p>External preliminary protection with max. C 10 A circuit breaker required for all cases.</p>	
 <p>Do not connect 3-speed fans in parallel!</p> <p>Connect one fan directly, one relay for each speed for additional fans.</p>	
Use for actuator control (Q1, Q2)	
<ul style="list-style-type: none"> Q1 - rating min., max. resistive/inductive Q2 - rating min., max. resistive/inductive Max total load current Q1+Q2+Q3 	5 mA...1 A 5 mA...1 A 5 A
Use for external equipment (Q1, Q2, Q3)	
<ul style="list-style-type: none"> Rating min., max. resistive/inductive Qx Max total load current Q1+Q2+Q3 	5 mA...1 A 2 A
DC 0...10 V fan control; Y50-M	SELV DC 0...10 V, max. ± 5 mA
Control outputs Y1, Y2, Y3, Y4-N	Solid state (triacs) AC 24 V or AC 230 V (linked to power supply)
Yx power limitation	8 mA...1 A 3 A fast microfuse, cannot be exchanged

Power supply (RDG260KN)	
Operating voltage (G-G0) DC 24 V: Make sure to connect G to + and G0 to -	AC 24 V $\pm 20\%$ DC 24 V ± 2 V
Frequency	50/60 Hz
Power consumption	4 VA @ AC 24 V
 <p>No internal fuse! External preliminary protection with max. C 10 A circuit breaker required for all cases.</p>	

Outputs (RDG260KN)	
Fan control Q1/Q2/Q3/L-N	AC 24...230 V / DC 24 V
Use for 3-speed fan control Rating min, max resistive (inductive)	AC 24...230 V: 5 mA...5 (4) A DC 24 V: 3 A
 <p>No internal fuse! External preliminary protection with max. C 10 A circuit breaker required for all cases.</p>	
<p>!</p> <p>Do NOT connect 3-speed fans in parallel! Connect one fan directly, for additional fans, one relay for each speed.</p>	
Use for actuator control (Q1, Q2)	
<ul style="list-style-type: none"> Q1 - rating min., max. resistive/inductive Q2 - rating min., max. resistive/inductive Max total load current Q1+Q2+Q3 	5 mA...1 A 5 mA...5 (4) A 5 A
Use for external equipment (Q1, Q2, Q3)	
<ul style="list-style-type: none"> Rating min., max. resistive/inductive Qx Max total load current Q1+Q2+Q3 	5 mA...1 A 2 A
 <p>No internal fuse! External preliminary protection with max. C 10 A circuit breaker required for all cases.</p>	
DC 0...10 V fan control (Y50-M)	SELV DC 0...10 V, max. ± 5 mA
Actuator control (Y10-G0/Y20-G0/Y30-G0 (G))	SELV DC 0...10 V, max. ± 1 mA

Multifunctional inputs
X1-M/X2-M/U1-M
Temperature sensor input

Multifunctional inputs	
Type	NTC 3k
Temperature range	-20...70 °C
Temperature sensor input	
Type	LG-Ni1000
Temperature range	-40...70 °C
Digital input	
Operating action	Selectable (NO/NC)
Contact sensing	DC 0...5 V, max. 5 mA
Insulation against mains	SELV

KNX bus	
Interface type	KNX, TP Uart 2 (electrically isolated)
Bus current	5 mA
Bus topology: See KNX manual ("Reference documentation")	

Operational data		
Switching differential, adjustable		
Heating mode	(P051)	1 K (0.5...6 K)
Cooling mode	(P053)	1 K (0.5...6 K)
P-band Xp		
Heating mode	(P050)	2 K (0.5...6 K)
Cooling mode	(P052)	1 K (0.5...6 K)
Setpoint setting and setpoint range		
Comfort mode	(P011)	21 °C (5...40 °C)
Economy mode	(P019-P020)	15 °C/30 °C (OFF, 5...40 °C)
Protection mode	(P100-P101)	8 °C/OFF (OFF, 5...40 °C)
Multifunctional inputs X1/X2/U1		Selectable (0...25)
Input X1 default value	(P150)	1 (external temperature sensor, room or return air)
Input X2 default value	(P153)	0 (no function)
Input U1 default value	(P155)	3 (window contact)

Operational data	
Built-in room temperature sensor	
Measuring range	0...49 °C
Accuracy at 25 °C	< ±0.5 K
Temperature calibration range	±3 K
Built-in humidity sensor	
Measuring range	10...90 %
Accuracy (after calibration via P007)	< 5 %
Humidity calibration range	±10 %
Settings and display resolution	
Setpoint	0.5 °C
Present temperature value displayed	0.5 °C

Environmental conditions	
Storage	IEC 60721-3-1
Climatic conditions	Class 1K3
Temperature	-25...65 °C
Humidity	< 95 % r.h.
Transport	IEC 60721-3-2
Climatic conditions	Class 2K3
Temperature	-25...65 °C
Humidity	< 95 % r.h.
Mechanical conditions	Class 2M2
Operation	IEC 60721-3-3
Climatic conditions	Class 3K5
Temperature	0...50 °C
Humidity	< 95 % r.h.

Standards and directives	
EU conformity (CE)	A5W00120120A*
Electronic control type	2.B (micro-disconnection on operation)
RCM conformity	A5W00120121A*

Standards and directives	
Safety class	II as per EN 60730
Pollution class	Normal
Degree of protection of housing	IP30 as per EN 60529
Eco design and labeling directives	Based on EU directive 813/2013 (Eco design directive) and 811/2013 (Labelling directive) concerning space heaters, combination heaters, the following classes apply:
RDG200KN <ul style="list-style-type: none"> Application with On/Off operation of a heater PWM (TPI) room thermostat, for use with On/Off output heaters 	Class I value 1 % Class IV value 2 %
RDG260KN <ul style="list-style-type: none"> Application with On/Off operation of a heater PWM (TPI) room thermostat, for use with On/Off output heaters 	Class I value 1 % Class IV value 2 %

Meets the requirements for eu.bac certification
 See product list at: <http://www.eubaccert.eu/licences-by-criteria.asp>




Application	Device	Actuator outputs	CA value (K)	License No.
Fan coil unit systems (2 pipes) Variable speed fan	RDG200KN	thermal actuator	Heating 0.4 Cooling 0.3	220019
	RDG260KN	motorized DC	Heating 0.1 Cooling 0.1	220020
Fan coil unit systems (2 pipes, 2 wires) Variable speed fan	RDG200KN	thermal actuator	Heating 0.1 Cooling 0.3	220019
	RDG260KN	motorized DC	Heating 0.1 Cooling 0.1	220020
Fan coil unit systems (4 pipes) Variable speed fan	RDG200KN	thermal actuator	Heating 0.4 Cooling 0.3	220019
	RDG260KN	motorized DC	Heating 0.1 Cooling 0.1	220020
Ceiling Systems	RDG260KN	motorized DC	Heating 0.2 Cooling 0.2	220020
		6-port control ball valves VWG41.10...	Heating 0.2 Cooling 0.4	220020
		6-port control ball valves VWG41.20...	Heating 0.2 Cooling 0.4	220020
Environmental compatibility	The product environmental declaration (RDG200KN: A5W00085404A*, RDG260KN: A5W00116569A*) contains data on environmentally compatible product design and assessments (RoHS compliance, materials composition, packaging, environmental benefit, disposal).			


General	
Connection terminals	Solid wires or stranded wires with wire-end sleeves 1 x 0.4...2.5 mm ² or 2 x 0.4...1.5 mm ²
Minimal wiring cross section on L, N, Q1, Q2, Q3, Y1, Y2, Y3, Y4	Min. 1.5 mm ²
Maximal wiring cross section on L, N, Q1, Q2, Q3, Y1, Y2, Y3, Y4	Max. 2.5 mm ²
Housing front color	RAL 9016 white
Weight without/with packaging RDG200KN RDG260KN	266 g/336 g 242 g/311 g

Reference documentation	Handbook for Home and Building Control - Basic Principles (EN: https://my.knx.org/shop/product?language=en&product_type_category=books&product_type=handbook DE: https://my.knx.org/shop/product?language=de&product_type_category=books&product_type=handbook)
Synco™	CE1P3127 Communication via KNX bus for Synco 700, 900 and RXB/RXL Basic documentation
Desigo	CM1Y9775 Desigo RXB integration – S-Mode CM1Y9776 Desigo RXB/RXL integration – individual addressing CM1Y9777 Third-party integration CM1Y9778 Synco integration CM1Y9779 Working with ETS

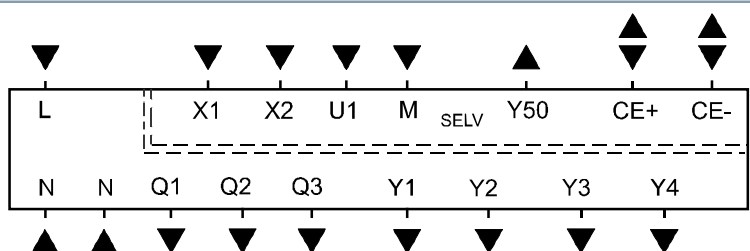*) The documents can be downloaded from <https://hit.sbt.siemens.com>.

RDG200KN

L, N	Operating voltage AC 230 V / AC 24 V
X1, X2	Multifunctional input for temperature sensor (NTC 3k or LG-Ni1000) or potential-free switch (function can be selected via parameter)
U1	Same as multifunctional inputs X1, X2
M	Measuring neutral for sensors and switches
CE+, CE-	KNX Bus + and – terminals
Q1	Control output for fan speed I AC 230 V / AC 24 V
Q2	Control output for fan speed II AC 230 V / AC 24 V
Q3	Control output for fan speed III AC 230 V / AC 24 V
Q1...Q3	Also for special functions AC 230 V / AC 24 V
Y1...Y4	Control outputs "Valve" AC 230 V or AC 24 V (NO triac, for normally open valves), output for electric heater via external relay
Y50	Control output "Fan" DC 0...10 V

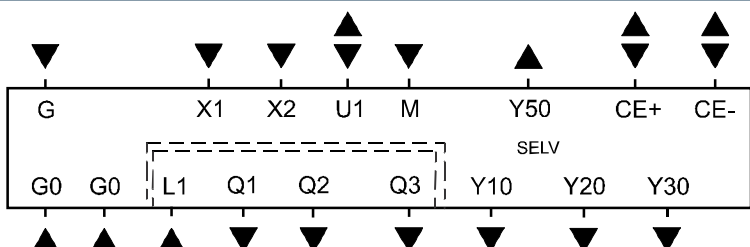RDG260KN

G, G0	Operating voltage AC 24 V / DC 24 V
L1	Feed for relays AC 24...230 V
X1, X2	Multifunctional input for temperature sensor (NTC 3k or LG-Ni1000) or potential-free switch (function can be selected via parameter)
U1	Selectable input / output function: Multifunctional input for temperature sensor (NTC 3k or LG-Ni1000) or potential-free switch (function can be selected via parameter) Multifunctional output for 2 nd stage cooling in 4-pipe/2-stage application
M	Measuring neutral for sensors and switches
CE+, CE-	KNX Bus + and – terminals
Q1 (L1)	Control output for fan speed I AC 230 V / AC 24 V
Q2 (L1)	Control output for fan speed II AC 230 V / AC 24 V
Q3 (L1)	Control output for fan speed III AC 230 V / AC 24 V
Q1...Q3 (L1)	Also for special functions AC 24...230 V
Y10, Y20, Y30	Control outputs "Valve" DC 0...10 V
Y50	Control output "Fan" DC 0...10 V

Connection diagrams

The connection workflow is as follows:

- Select fan control type: DC or 3-speed fan
- Select application type, e.g. 4-pipe
- Columns V1, V2, V3, V4 show the type of the outputs (e.g. for 4-pipe: YH for heating and YC for cooling) as well the available control signals
- Select the requested control output signals (e.g. 2-pos for heating, 2-pos for cooling)
- Equipments V1, V2 etc. stands for the connected equipment on each terminal, e.g. 4-pipe with outputs of 2-pos and 2-pos, V1 (valve actuator) connects to Y1 and V2 (valve actuator) to Y2


Notes

- "2-pos" can be used for control signal On/Off and PWM
- For universal application, fan function needs to be switched off via P359

N1	Room thermostat RDG200KN	M1	1-speed or 3-speed fan, DC 0...10 V fan
S1, S2, S3	Switch (keycard, window contact, presence detector etc.)	B1, B2, B3	Temperature sensor (return air temperature, external room temperature, changeover sensor, etc.)
V1, V2, V3, V4	Valve actuators: On/Off or PWM, 3-position, heating, cooling, radiator, heating/cooling, 1 st or 2 nd stage	YH	Heating valve actuator
YE	Electric heater	YC	Cooling valve actuator
K	Relay	YHC	Heating/cooling valve actuator
CE+	KNX data +	YR	Radiator valve actuator
CE-	KNX data -	YHC1/YH1/ YH2/YHC2/ YC1/YC2	1 st /2 nd stage

RDG260KN				DC 0...10 V fan										1-speed/3-speed fan									
Application				Equipment				Terminals						Terminals									
	V1				Q1			Y10				Y50	Q1, Q2, Q3	Y10									
2-pipe	YHC																						
Control outputs:	DC						V1				✓	✓	✓	V1									
	On/Off				V1																		
Application				Equipment				Terminals						Terminals									
	V1	V2			Q1	Q2	Y10	Y20		Y50	Q1, Q2, Q3	Y10	Y20										
2-pipe + RAD	YHC	YR																					
4-pipe	YH	YC																					
2-pipe/2-stage	YHC1	YHC2																					
Control outputs:	DC		DC				V1	V2		✓	✓	V1	V2										
	DC		On/Off			V2	V1																
	On/Off		DC		V1			V2															
	On/Off		On/Off		V1	V2																	
Application				Equipment				Terminals						Terminals									
	V1	V2			Q1	Q2	Y10	Y20		Y50	Q1, Q2, Q3	Y10	Y20										
2-pipe with electric heater	YHC	YE																					
Control outputs:	DC		DC				V1	V2		✓	✓	V1	V2										
	DC		On/Off			V2	V1																
	On/Off		DC		V1			V2															
	On/Off		On/Off		V1	V2																	
Application				Equipment				Terminals						Terminals									
	V1	V2	V3			Q2	Y10	Y20	Y30	Y50	Q1, Q2, Q3	Y10	Y20	Y30									
4-pipe with electric heater	YH	YC	YE																				
Control outputs:	DC		DC				V1	V2	V3	✓	✓	V1	V2	V3									
	DC		On/Off			V3	V1	V2															
Application				Equipment				Terminals						Terminals									
	V1	V2	V3	V4		U1	Y10	Y20	Y30	Y50	Q1, Q2, Q3	Y10	Y20	Y30	U1								
4-pipe/2-stage	YH1	YC1	YH2	YC2																			
Control outputs:	DC		DC			V4	V1	V2	V3	✓	✓	V1	V2	V3	V4								
	DC		On/Off																				

N1	Room thermostat RDG260KN	M1	1-speed or 3-speed fan, DC 0...10 V fan
S1, S2, S3	Switch (keycard, window contact, presence detector etc.)	V1, V2, V3, V4	Valves actuators: On/Off or DC 0...10 V, heating, cooling, radiator, heating/cooling, 1 st or 2 nd stage
YE	Electric heater	B1, B2, B3	Temperature sensor (return air temperature, external room temperature, changeover sensor, etc.)
YH	Heating valve actuator	YHC	Heating/cooling valve actuator
YC	Cooling valve actuator	YR	Radiator valve actuator
CE+	KNX data +	YHC1/YH1/YH2/ YHC2/YC1/YC2	1 st /2 nd stage
CE-	KNX data -		

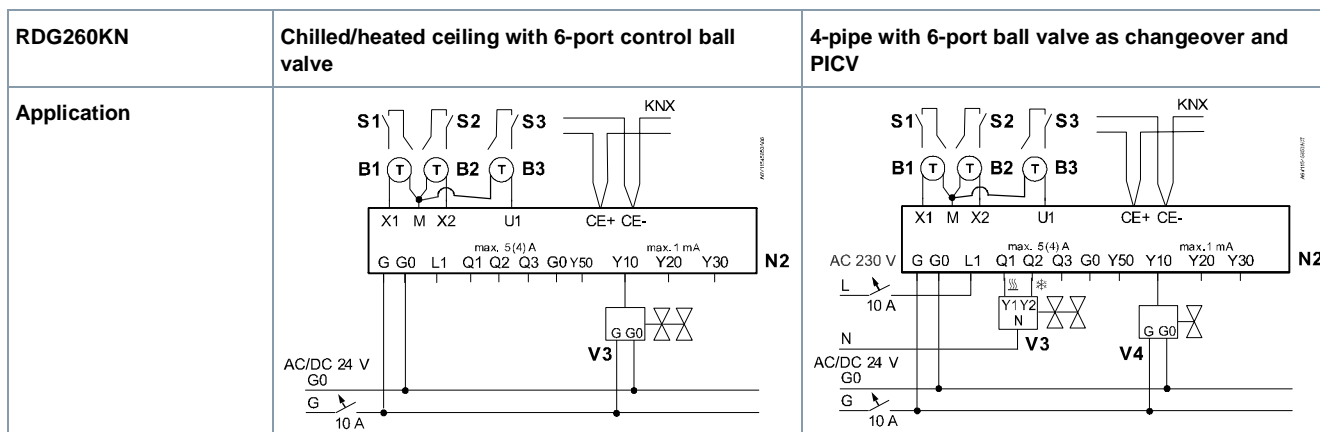


N2	Room thermostat RDG260KN	V3	6-port modulating control actuator
S1, S2, S3	Switch (keycard, window contact, presence detector etc.)	V4	PICV control valve
B1, B2, B3	Temperature sensor (return air temperature, external room temperature, changeover sensor, etc.)		
CE-	KNX data -	CE+	KNX data +


Note: In application "4-pipe with 6-port ball valve as changeover and PICV", Y50 can be connected with a DC 0...10 V fan.

Dimensions

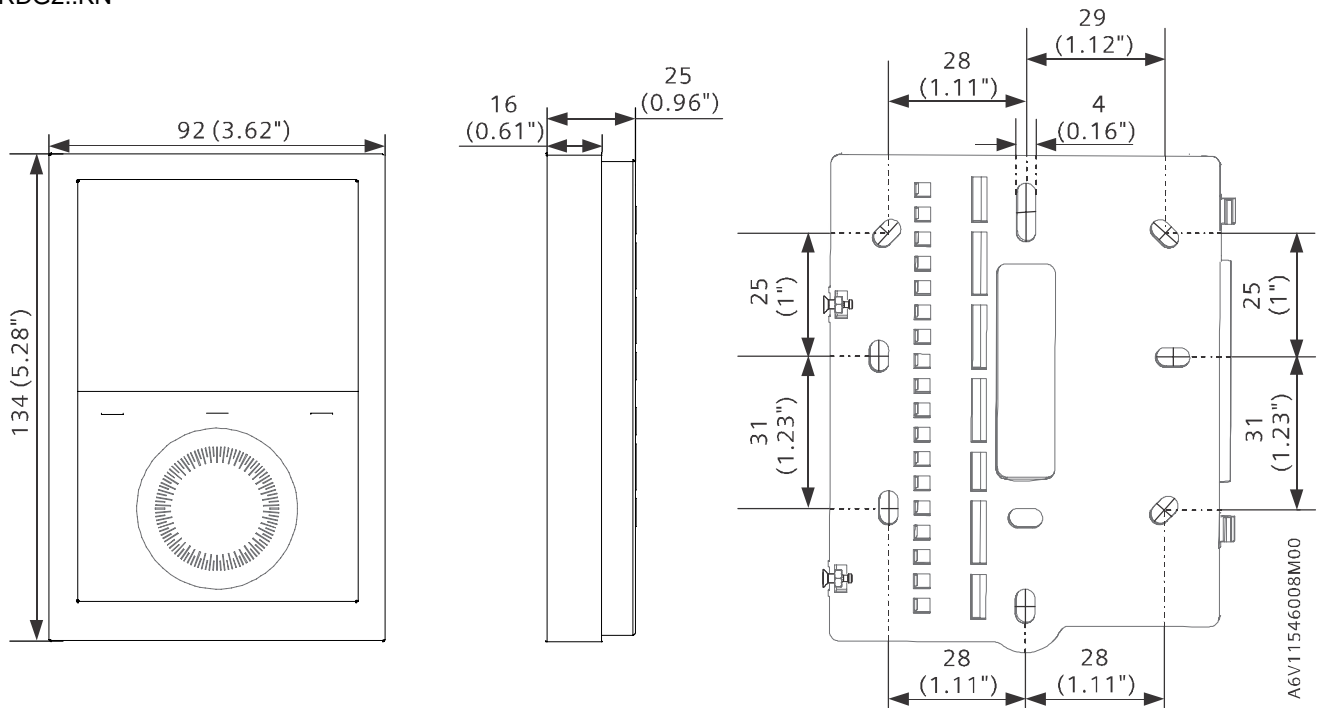RDG2..KN



ARG200

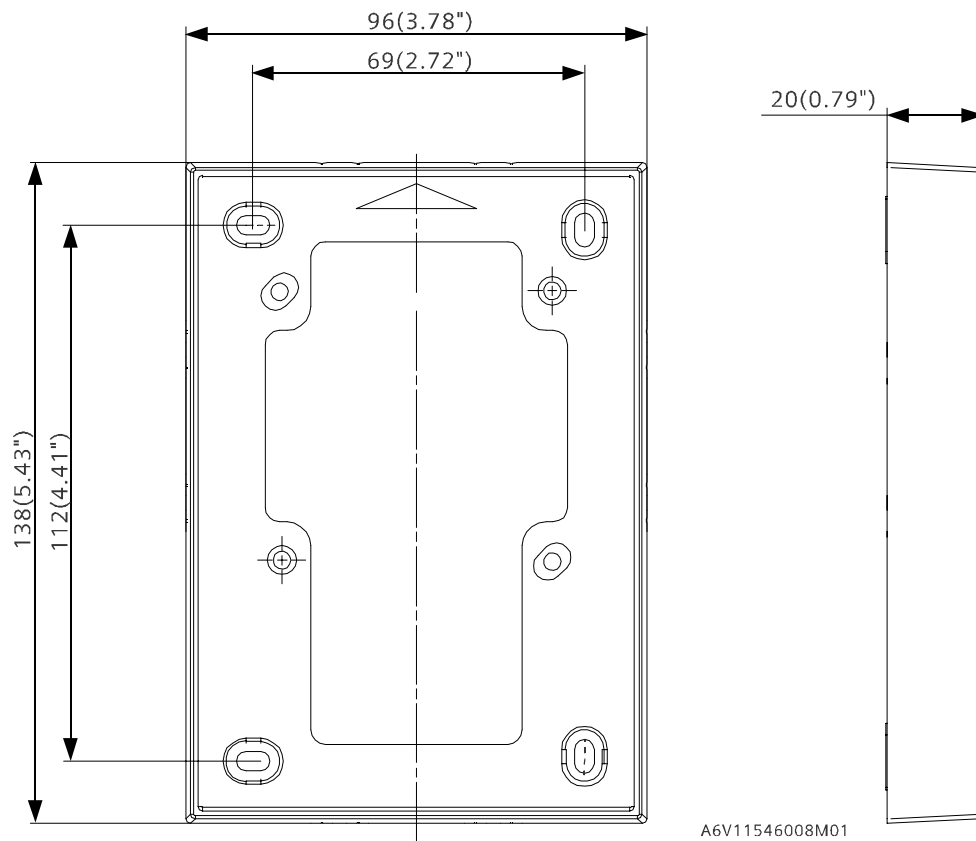

Dimensions in mm (inch)

Issued by
Siemens Switzerland Ltd
Smart Infrastructure
Global Headquarters
Theilerstrasse 1a
CH-6300 Zug
+41 58 724 2424
www.siemens.com/buildingtechnologies

© Siemens Switzerland Ltd, 2020
Technical specifications and availability subject to change without notice.